COPY

EMERY ROTH & SONS, ARCHITECTS
850 THIRD AVENUE
NEW YORK 22, N. Y.

MINORU YAMASAKI & ASSOCIATES
PROJ. NO. 6211
SUBJECT EHQ-12
DEC 3 1965
ANSWER TO

December 23, 1965

Mr. Malcolm P. Levy
The Port of New York Authority
111 Eighth Avenue
New York, N.Y. 10011

Re: Sprayed-on Fireproofing
World Trade Center

Dear Mal:

This supplements my December 14th letter to you.

Although the one-inch thick sprayed-on fireproofing meets the 3-hour requirements of both the proposed Building Code and Underwriters, advance information from manufacturers indicates that if the truss were required to be fire-tested, then two inches of material would be required for the light angle members. We are therefore revising our working drawings to indicate a one-inch thickness of sprayed-on fireproofing around the top and bottom chords of the trusses, and a two-inch thickness for all other members of the trusses.

By informational copy of this letter, all consultants are requested to review their designs and drawings, and to make all necessary changes to meet this new criteria.

Sincerely,

EMERY ROTH & SONS

BY: _____
JULIAN ROTH

JR:ml
cc: Leslie Robertson
Aaron Schreier
Joseph R. Loring & Associates
Jaros, Baum & Bolles
J. Solomon

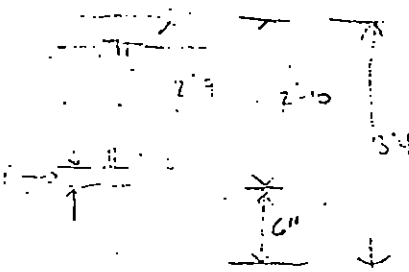

PA LAW DEPARTMENT
58881